




Rough-In Diagram

Prodigy 5 - Flue Damper Model

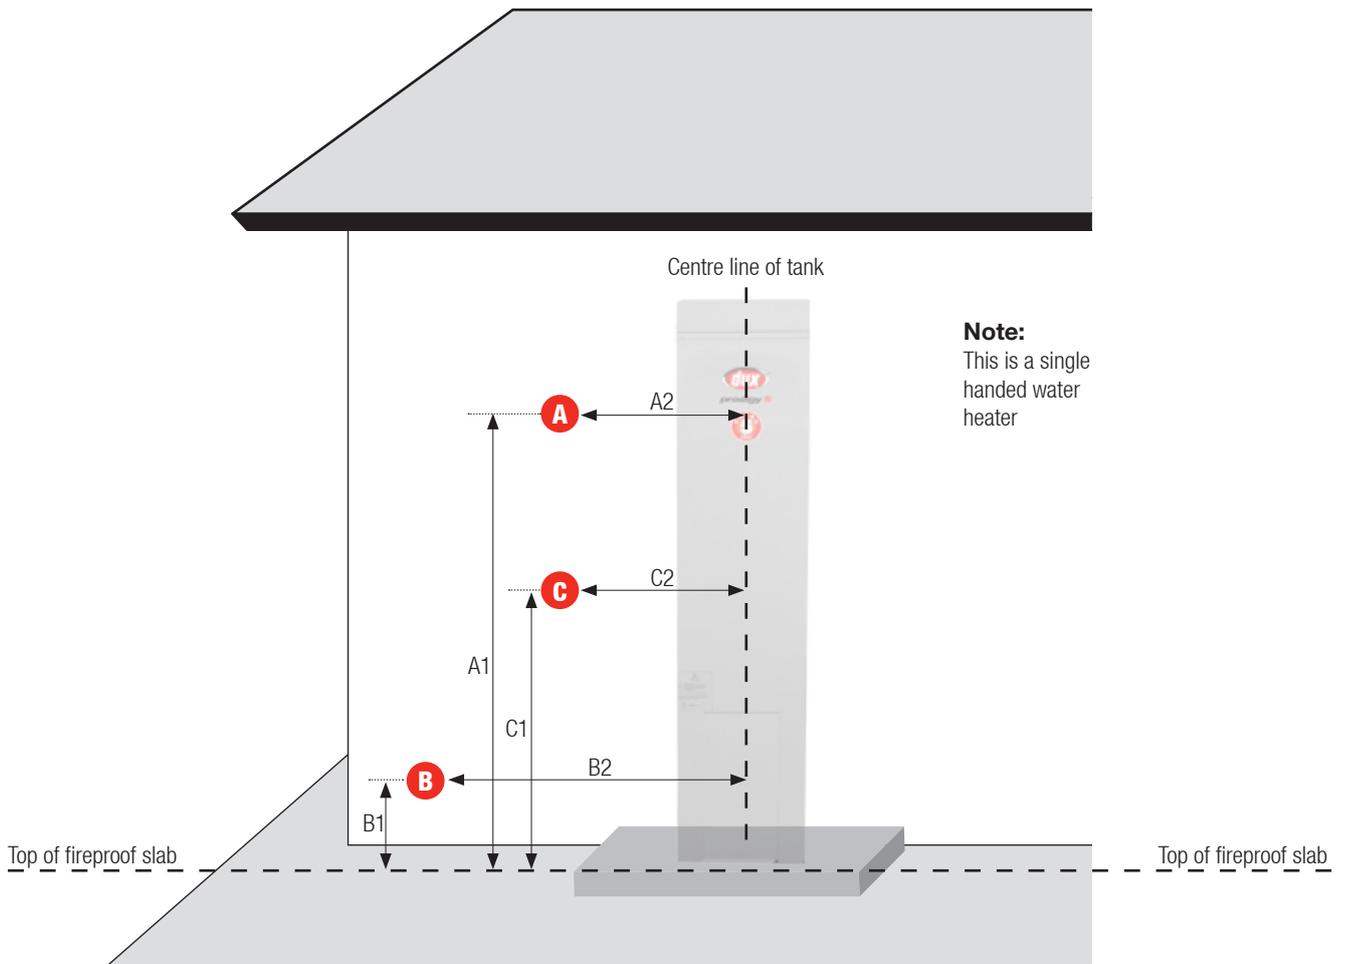

			135 L	170 L
	Tank Height		1610	1910
	Tank Width		422	422
A	Hot water outlet from top of fireproof slab	A1	1320	1620
	Hot water outlet from centre line of tank	A2	310	310
B	Cold water inlet from top of fireproof slab	B1	220	220
	Cold water inlet from centre line of tank (allowing 300mm for valve train)	B2	510	510
C	Tempered water outlet from top of fireproof slab (mid-way between A1 and B1)	C1	550	700
	Tempered water outlet from centre line of tank	C2	310	310



Approximate location of pipework (rounded to the nearest 10mm). A tolerance of 25mm is acceptable to dimensions shown in table. Pipes to be left horizontally and protruding a minimum of 350mm.

Horizontal dimensions shown in table allow for 100mm pipework from side of tank (i.e. Centreline + (Diameter or Width × 0.5) + 100).