


RADIANT HOT WATER Rough-In Diagram

Radiant Heat Pump

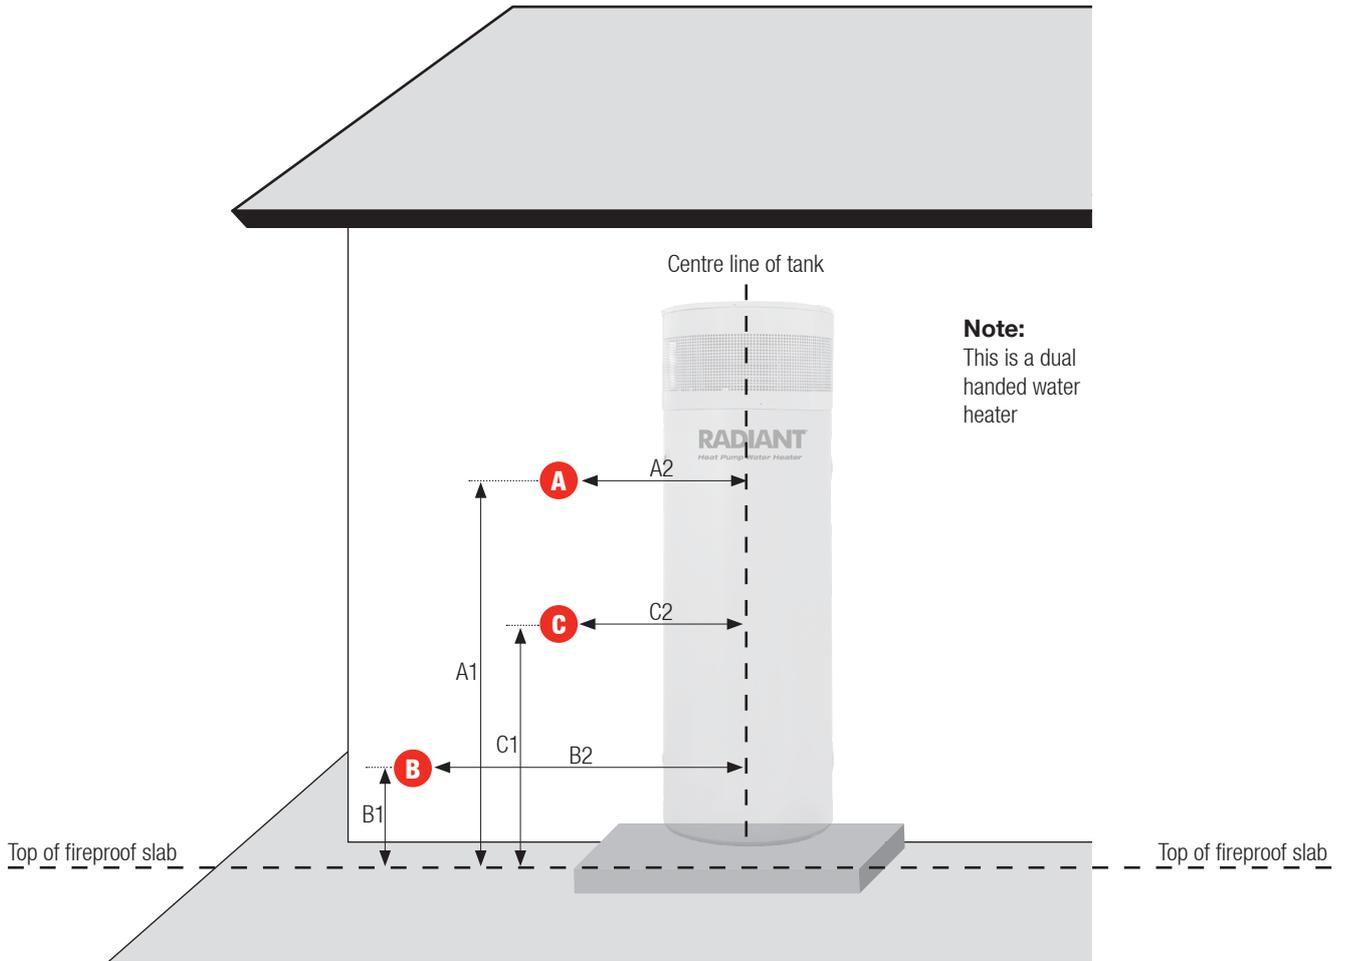

			250 L
	Tank Height		1755
	Overall diameter		632
A	Hot water outlet from top of fireproof slab	A1	1230
	Hot water outlet from centre line of tank	A2	420
B	Cold water inlet from top of fireproof slab	B1	220
	Cold water inlet from centre line of tank (allowing 300mm for valve train)	B2	620
C	Tempered water outlet from top of fireproof slab (mid-way between A1 and B1)	C1	720
	Tempered water outlet from centre line of tank	C2	420

● Approximate location of pipework (rounded to the nearest 10mm). A tolerance of 25mm is acceptable to dimensions shown in table.
 Pipes to be left horizontally and protruding a minimum of 350mm.
 Horizontal dimensions shown in table allow for 100mm pipework from side of tank (i.e. Centreline + (Diameter or Width × 0.5) + 100).